

Social Safeguards Monitoring Report

Reporting Period 01 January 2025 to 30 June, 2025
Date 06 July 2025
Loan Number- 4402

Uttarakhand Climate Resilient Power System Development Project

Prepared by the [Power Transmission Corporation of Uttarakhand Ltd.\(PTCUL\)](#) for the Asian Development Bank

This social safeguard monitoring report is a document of the borrower and made publicly available in accordance with ADB's Access to Information Policy 2018 and the Safeguard Policy Statement 2009. The views expressed herein do not necessarily represent those of ADB's Board of Directors, Management, or staff.

LIST OF ABBREVIATIONS

ADB	Asian Development Bank
ckm	circuit kilometre
CSS	compact substation
EDD	Electricity Distribution Directorate
EHV	Electricity High Voltage
EMP	Environment Management Plan
EPC	Engineering, procurement, and construction
GRM	grievance redress mechanism
ha	hectare
HDD	horizontal directional drilling
HVDC	High Voltage Direct Current
km	kilometre
kV	kilovolt
LILO	Line In Line Out
LT	Low Tension
m ²	square meter
MOP	Ministry of Power
PIU	Project Implementation Unit
PMU	Project Management Unit
PTCUL	Power Transmission Corporation of Uttarakhand Limited
RMU	Ring Main Unit
ROW	right of way
UPCL	Uttarakhand Power Corporation Limited
UREDA	Uttarakhand Renewable Energy Development Agency
GoU	Government of Uttarakhand

TABLE OF CONTENTS-

- 1. Executive Summary**
- 2. Introduction**
- 3. Brief Project Description**
- 4. Project Progress Status and Implementation Schedule**
- 5. Land Acquisition and Compensation Progress Status**
- 6. Compliance with National Regulations and International Agreements**
- 7. Compliance with Social Safeguards Covenants from the ADB Loan Agreement**
- 8. Compliance with Project Administration Manual (PAM)**
- 9. Compliance with Entitlement Matrix**
- 10. Social Supervision**
- 11. Meaningful Consultation and Grievance Redress**
- 12. Appendix -A**
- 13. Appendix -B**

Executive Summary

Project Name	
Executing Agency	GoU
Implementing Agency	PTCUL
- Involuntary Resettlement Safeguards Categorization - Indigenous Peoples Safeguards Categorization	categorized “B” for Involuntary Resettlement (IR) categorized “C” for Indigenous Peoples (IP),
Resettlement and/or Indigenous Peoples Safeguards Documentation	https://www.adb.org/projects/51308-008/main
Summary of Involuntary Resettlement and/or Indigenous Peoples Impacts	Substations proposed on land allotted by GoU and UPCL and purchase from Private owners. No compulsory land acquisitions Tower foundation, erection, and stringing require temporary compulsory land acquisitions Limited physical/economic displacement no impacts on Indigenous Peoples
Project Stage Obtained	Construction
Detailed Design Required Post-Approval	Yes, Detail Design/ Engineering and construction work in progress,
Contract(s) Awarded	- Construction of 220 KV Substation Selaqui, Dehradun awarded to Flowmore Limited, JV with Jiangsu Jingdian Electric Co., Ltd., (Package-1, Lot-1) – Contract awarded & LoA issued - Construction of 4 Nos. 132 KV Substations - Construction of 132/33 kV GIS substation Araghar Construction of 132/33 kV GIS substation Dhaulakhera Construction of 132/33 kV GIS substation Khatima-II Construction of 132/33 kV GIS substation Lohaghat awarded to Flowmore Limited, JV with Jiangsu Jingdian Electric Co., Ltd (Package-1, Lot-2) – Contract awarded & LoA issued - Construction of 220/132/33kV (2X160 MVA + 2x40 MVA AIS Substation, Manglore, Haridwar. awarded to M/s Trans Global Power Limited. (Package-2,) – Contract awarded & LoA issued - Construction of LILO of 220kV Roorkee-Nara line at proposed 220kV Substation, Manglore awarded to M/s Salasar Techno Engineering Ltd (Package-3, Lot-1) – Contract awarded & LoA issued - Construction of (a) LILO of 132 kV Mangalore-Asahi Line & Mangalore –Air Liquid Line at 220 KV S/s Magalore (b) LILO of 132 kV Kathgodam –Rudrapur Line at 132 kV Substation Dhaulakhera (haldwani) (c) LILO of 132 KV Khatima- Sitarganj Line at Proposed 132/33 kV

	Substation Khatima-II & (d) Stringing of second circuit of 132 kV D/C Transmission Line on Panther conductor from Pithoragarh (PGCIL) _Champawat (Lohaghat) awarded to M/s BTL EPC Ltd. , 2 Jessore Road, Dum Dum Kolkata-700028 (Package -3, Lot-2) – Contract Awarded & LoA issued. 6. Construction of LILO of 220 kV Khodri-Jhajra Line at proposed 220 kV Substation Selaqui Dehradun with Underground Cable awarded to M/s Rajesh Power Services Pvt.Ltd. (Package-4, Lot-1) – Contract awarded & LoA issued 7. Construction of LILO of 132 kV Majra-Laltappar Line at proposed 132 kV Substation Araghar Dehradun Through 132 kV Underground Cable awarded to M/s Aquarian Enterprises (Package-4, Lot-2) – Contract awarded & LoA issued	
Bidding Document(s) Include Relevant Involuntary Resettlement and/or Indigenous Peoples Provisions	N/A	
Contract(s) Awarded Include Relevant Involuntary Resettlement and/or Indigenous Peoples Provisions	N/A	
Contractor(s) Given Access to Site	Yes	
Construction Progress (%)	➤ Construction of 220 KV Substation Selaqui	49%
	➤ Construction of LILO of 220 kV Khodri-Jhajra Line at proposed 220 kV Substation Selaqui Dehradun with Underground Cable	18%
	➤ Construction of LILO of 132 kV Majra-Laltappar Line at proposed 132 kV Substation Araghar Dehradun Through 132 kV Underground Cable	8%
	➤ Construction of 132/33 kV GIS substation Araghar-	39%
	➤ Construction of 132/33 kV GIS substation Dhaulakhera	41%
	➤ Construction of 132/33 kV GIS substation Khatima-II	46%
	➤ Construction of 132/33 kV GIS substation Lohaghat	41%
	➤ LILO of 132 kV Mangalore-Asahi Line & Mangalore – Air Liquid Line at 220 KV S/s Magalore	20%
	➤ LILO of 132 kV Kathgodam –Rudrapur Line at 132 kV Substation Dhaulakhera (Haldwani)	20%
	➤ LILO of 132 KV Khatima- Sitarganj Line at Proposed 132/33 kV Substation Khatima-II	20%
	➤ Stringing of second circuit of 132 kV D/C Transmission Line on Panther conductor from Pithoragarh (PGCIL) Champawat	30%

	➤ Construction of 220/132/33kV AIS Substation, Manglore	20%
	➤ Construction of LILO of 220kV Roorkee-Nara line at proposed 220kV Substation, Manglore-	10%
Unanticipated Impacts including Change of Scope or Design	No	
Number of Site Inspections and Audits Undertaken by IA Safeguards Staff during Reporting Period	78(Line+Substation)	
Corrective Action Required from Previous Reporting Period	N/A	
Outstanding Corrective Action this Reporting Period	N/A	
Non-Compliances Recorded this Reporting Period	Most of correction action has been compiled and LoA for appointment of PISC has been issued on dated 30.06.2025	
Corrective Action Required	Yes	
GRM Functional	Yes (Attached in Appendix A)	
Number of Unresolved Grievances from Prior Reporting Period	Nil	
Number of Grievances Received in Reporting Period	Nil	
Number of Grievances Resolved this Reporting Period	Nil	
Number of Grievances Still Outstanding	Nil	
Number of Grievances referred to Court of Law	Nil	
Number of Grievances referred to the Accountability mechanism	Nil	

1.0 Introduction

1.1 Brief Project Description

Power Transmission Corporation of Uttarakhand Limited (referred as PTCUL) is a Government of Uttarakhand Enterprise and a Government Company under the companies Act, 1956. The objective of PTCUL is to acquire, establish, construct and operate extra high voltage, high voltage, medium voltage and low voltage lines and associated sub-stations equipment apparatus, cable & wires and co-ordination of Transmission facilities for the state of Uttarakhand. PTCUL is the STU as defined in Electricity Act 2003, responsible for building, operating and maintaining transmission substations and lines at EHV of 132kV, 220kV, 400 kV & above. It was carved out of UPCL in June 2004 as a part of Power Sector Reforms process. PTCUL is also responsible for Load Dispatch and Energy Management functions in the state through LDCs. As corporate entity, PTCUL aims to implement best practices of Project Implementation and Operations & Maintenance Management to ensure efficiency, reliability and commercial viability of power transmission system in the State.


The project will support the Government of Uttarakhand in strengthening its power system network to meet future electricity demand growth and to improve quality and reliability of power supply to its consumers. The primary focus of the project is the climate resilience of the Uttarakhand power systems.

PTCUL will be the implementing agency of this project while GOU (government of Uttarakhand) shall be Executing agency of this project. The details of works and package are mentioned hereunder-

1. Construction of 220 KV Substation Selaqui, Dehradun awarded to Flowmore Limited, JV with Jiangsu Jingdian Electric Co., Ltd., **(Package-1, Lot-1) – Contract awarded & LoA issued**
2. Construction of 4 Nos. 132 KV Substations -
Construction of 132/33 kV GIS substation Araghar
Construction of 132/33 kV GIS substation Dhaulakhera
Construction of 132/33 kV GIS substation Khatima-II
Construction of 132/33 kV GIS substation Lohaghat
awarded to Flowmore Limited, JV with Jiangsu Jingdian Electric Co., Ltd
(Package-1, Lot-2) – Contract awarded & LoA issued
3. Construction of 220/132/33kV (2X160 MVA + 2x40 MVA AIS Substation, Manglore, Haridwar, Awarded to M/s Trans Global Power Limited.
(Package-2,) – Contract awarded & LoA issued
4. Construction of LILO of 220kV Roorkee-Nara line at proposed 220kV Substation, Manglore awarded to M/s Salasar Techno Engineering Ltd
(Package-3, Lot-1) – Contract awarded & LoA issued
5. Construction of (a) LILO of 132 kV Mangalore-Asahi Line & Mangalore –Air Liquid Line at 220 KV S/s Magalore (b) LILO of 132 kV Kathgodam –Rudrapur Line at 132 kV Substation Dhaulakhera (haldwani) (c) LILO of 132 KV Khatima- Sitarganj Line at Proposed 132/33 kV Substation Khatima-II & (d) Stringing of second circuit of 132 kV D/C Transmission Line on Panther conductor from Pithoragarh (PGCIL) _ Champawat (Lohaghat) awarded to M/s BTL EPC Ltd. , 2 Jessore Road, Dum Dum Kolkata-700028 (**Package -3, Lot-2) – Contract Awarded & LoA issued.**

6. Construction of LILO of 220 kV Khodri-Jhajra Line at proposed 220 kV Substation Selaqui Dehradun with Underground Cable awarded to M/s Rajesh Power Services Pvt.Ltd.
(Package-4, Lot-1) – Contract awarded & LoA issued
7. Construction of LILO of 132 kV Majra-Laltappar Line at proposed 132 kV Substation Araghar Dehradun Through 132 kV Underground Cable awarded to M/s Aquarian Enterprises **(Package-4, Lot-2) – Contract awarded & LoA issued.**

Organogram of safeguards staffing at PIU level

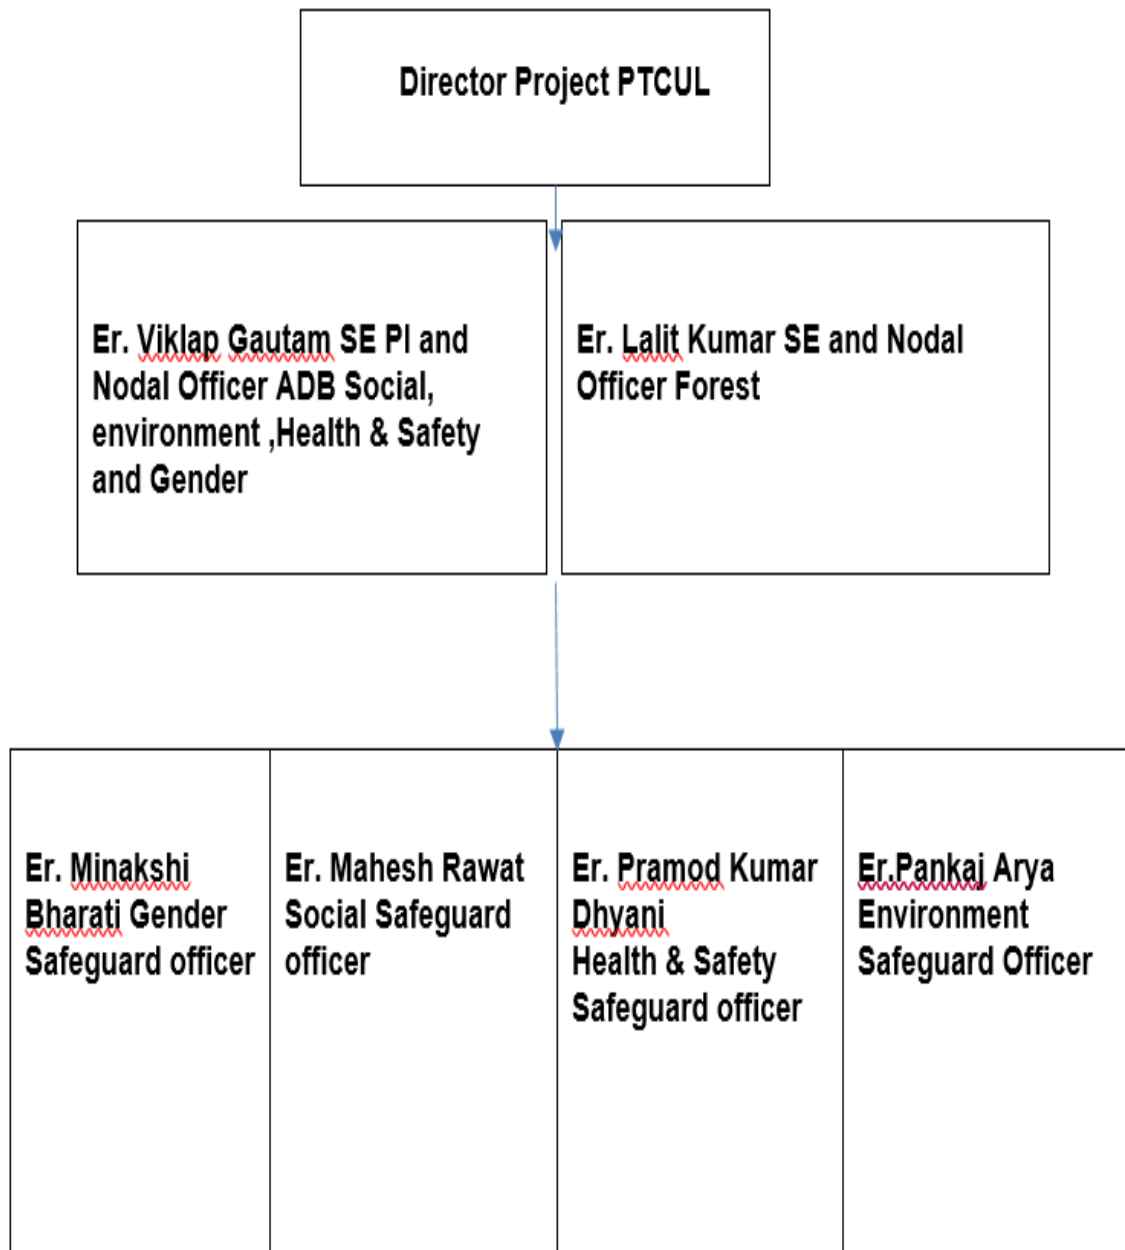

Project Key Personnel from Contractor for ADB works All Package

S.No.	Package & Lot	Substation/Line	Project Manager	Environment & Social officer	Health & Safety officer	Remark
1	Package-1 (Lot-1)	Selaqui	Mr. Amit Goel 8586967345	Mr. Nitesh Chauhan 9805941294	Mr. Pankaj 8545006399	
2	Package -1 (Lot-2)	Lohaghat,		Mr. Avdesh Joshi 9557198336	Mr. Jane Alam 9838792673	
		Dhaulakhera,			Mr. Dheeraj Singh 7860671546	
		khatima			Mr. Sunil Kumar 9262390805	
		Araghar		Mr. Nitesh Chauhan 9805941294	Mr. Pankaj 8545006399	
3	Package -2	Manglore	Mr. Neeraj Tiwari 8449959288	Mr. Srini Dasappa	Mr. Arvind Tivari 9878869143	
4	Package-3 (Lot-1)	Construction of LILO of 220kV Roorkee-Nara line at proposed 220kV Substation, Manglore	Mr. Monit Goel 9818515858		Mr. Markandeshwar Pandey 9415570703	
5	Package-3 (Lot-2)	Construction of (a) LILO of 132 kV Mangalore-Asahi Line & Mangalore –Air Liquid Line at 220 KV S/s Magalore (b) LILO of 132 kV Kathgodam –Rudrapur Line at 132 kV Substation Dhaulakhera (haldwani) (c) LILO of 132 KV Khatima- Sitarganj Line at Proposed 132/33 kV Substation Khatima-II & (d) Stringing of second circuit of 132 kV D/C Transmission Line on Panther conductor from Pithoragarh (PGCIL) _Champawat (Lohaghat)	Mr. Dharmendra Yadav 8979857315			
6	Package-4 (Lot-1)	Construction of LILO of 220 kV Khodri-Jhajra Line at proposed 220 kV Substation Selaqui Dehradun with Underground Cable	Mr. Karan Singh 9899696406			
7	Package-4 (Lot-2)	Construction of LILO of 132 kV Majra-Laltappar Line at proposed 132 kV Substation Araghar Dehradun Through 132 kV Underground Cable	Mr. Raman Singh 7678242983			

1.2 Project Progress Status and Implementation Schedule

Project Component/Stage/ Activity	Target Completion Date	Progress Status	Percent Completed	Remarks
Construction of 220/33KV (2x40MVA) GIS Substation Selaqui	730 Days from the effective date of contract	Drawing Submission and engineering construction work in progress.	49%	Contract awarded to Flowmore Limited JV with Jiangsu Jingdian Electric Co. through Flowmore Limited (Representative on behalf of JV)
Construction of LILO of 220 kV Khodri-Jhajra Line at proposed 220 kV Substation Selaqui Dehradun with Underground Cable	540 Days from the effective date of contract	Route finalized, Drawings approval, detailed engineering & supply work in progress.	18%	Contract awarded to M/s Rajesh Power Services Pvt.Ltd.
Construction of LILO of 132 kV Majra-Laltappar Line at proposed 132 kV Substation Araghar Dehradun Through 132 kV Underground Cable	540 Days from the effective date of contract	Route finalized, Drawings approval, detailed engineering & supply work in progress.	8%	Contract awarded to M/s Aquarian Enterprises
Construction of 4 Nos. 132 KV Substations (Aaraghar Dhaulakhera, Khatima-II, & Lohaghat)	730 Days from the effective date of contract	Construction activity is under progress, and various supply material have been reached at sites.	41%	Contract awarded to Flowmore Limited JV with Jiangsu Jingdian Electric Co. through Flowmore Limited (Representative on behalf of JV)

Construction of (a) LILO of 132 KV Mangalore-Asahi Line & mangalore – Air Liquid line at 220 KV Substation Mangalore (b) LILO of 132 kv kathgodam-Rudrapur Line at 132 Kv Substation Dhaulakhera (Haldwani) (C) LILO of 132 kv Khatima-Sitarganj Line at Proposed 132/ 33 kv Substation Khatima-II & (d) Stringing of second circuit of 132 kv D/C Transmission Line on Panther conductor from Pithoragarh (PGCIL) – Champawat (Lohaghat)	540 Days from the effective date of contract	Design and engineering construction in under process, and various supply material have been reached at site.	22.5%	Contract awarded to BTL EPC Ltd., 2 jessore Road, Dum Dum Kolkata-700028
220/132/33kv (2X160 MVA + 2x40 MVA AIS Substation, Manglore, Haridwar.	730 Days from the effective date of contract	Project Zero dated started and Drawing Submission and planning engineering construction work are in progress.	20%	Contract awarded M/s Trans Global Power Limited
LILO of 220kV Roorkee-Nara line at proposed 220kV Substation, Manglore.	540 Days from the effective date of contract	Route finalized, Drawings approval and detailed engineering work in progress	10%	Contract awarded M/s Salasar Techno Engineering Ltd.

1.3 Land Acquisition and Compensation Progress Status

S L	Location	Total Area (Acre)	Area to be Acquired (Acre)	No of Affected Household (No. of Persons)	Acquisition Method	Status	Remark
1-	220KV Selaqui Substation	0.730	NIL	NIL	Allotment by GoU(SIDCUL)	In possession	NIL
2	220/132/33kV (2X160 MVA + 2x40 MVA AIS Substation, Manglore,	6.662	NIL	NIL	Purchase from Private Owners and acquisition completed.	In possession	NIL
3	132 KV Substations Aaraghar	1.075	NIL	NIL	Allotment from UPCL	In possession.	NIL
4	132 KV Substations Dhaulakhera	0.494	NIL	NIL	Allotment from UPCL	In possession	NIL
5	132 KV Substations Khatima-II,	2.891	NIL	NIL	Allotment from GOU	In possession	NIL
6	132 KV Substations Lohaghat	1.976	NIL	NIL	Allotment from GOU	In possession	NIL
7	132 KV S/S Sarverkhera	Land allotted by GOU & Tendering in Progress					
8	400 kv S/S Laundhaura	Proposal Dropped					
TOTAL		13.828					

1.4 Compensation is required without any land title transfer such as for lines, then present status of compensation

Since the work has just started and all works in preliminary design stage as the work gradually progress, detail of compensation for lines shall be provided.

Name of Lines	Length (km)	Installation of 11 kV and below line (km)	Private Land (Y/N)	No of Affected Household (Persons)	Compensation Status	Remark
LILO of 220kV Roorkee-Nara line	0.915	Nil	Yes	6(approx.)	Yet to be paid	Till the reporting date 06 Household identified and rest will be updated after further identification.
Construction of LILO of 220 kV Khodri-Jhajra Line at proposed 220 kV Substation Selaqui Dehradun with Underground Cable	0.70	N/A	N/A	NIL	NIL	N/A
Construction of LILO of 132 kV Majra-Laltappar Line at proposed 132 kV Substation Araghar Dehradun Through 132 kV Underground Cable	3.6	N/A	N/A	NIL	NIL	N/A
LILO of 132 KV Mangalore-Asahi Line & mangalore – Air Liquid line at 220 KV Substation Manglore	0.472	Nil	Yes	6(Approx)	Yet to be paid	Detailed line survey completed .04 no family identified till reporting date.
LILO of 132 kV kathgodam-Rudrapur Line at 132 Kv Sub-station Dhaulakhera (Haldwani)	0.315	Nil	No	Nil	N/A	Detailed line survey completed and the line shall be pass though Irrigation deptt land.

LILO of 132 kV Khatima- Sitarganj Line at Proposed 132/ 33 kV Substation Khatima-II	0.550	Nil	Yes	04	Yet to be paid	Detailed line survey completed .04 no family identified till reporting date.
Stringing of second circuit of 132 kv D/C Transmission Line on Panther conductor from Pithoragarh (PGCIL)– Champawat (Lohaghat)	39.33	Nil	No	Nil	Nil	Line already constructed only stringing is to be done
Total						

2.0 Compliance with National Regulations and International Agreements

National Regulation or International Agreement	Compliance Requirements under the Regulation or Agreement	Compliance Status	Remarks
As per ADB Norms	As per ADB Norms	Complied as per requirement	NIL

3.0 Compliance with Social Safeguards Covenants from the ADB Loan Agreement

Schedule IV Para 9	Covenant The Borrower shall ensure, or cause the EA and each IA to ensure, that the preparation, design, construction, implementation, operation and decommissioning of the Project and all Project facilities comply with (a) all applicable laws and regulations of the Borrower and the State relating to environment, health and safety; (b) the Environmental Safeguards; and (c) all measures and requirements set forth in the IEE and EMP, and any corrective or preventative actions set forth in a Safeguards Monitoring Report.	Compliance Status Being Complied	Remarks
Schedule IV Para 10	The Borrower shall ensure, or cause the EA and each IA to ensure, that all land and all rights-of-way required for the Project are made available to the Works contractor in accordance with the schedule agreed under the related Works contract and all land acquisition and resettlement activities are implemented in compliance with (a) all applicable laws and regulations of the Borrower and the State relating to land acquisition and involuntary	Being Complied	

	resettlement; (b) the Involuntary Resettlement Safeguards; and (c) all measures and requirements set forth in the RP, and any corrective or preventative actions set forth in the Safeguards Monitoring Report.		
Schedule IV Para 11	Without limiting the application of the Involuntary Resettlement Safeguards or the RP, the Borrower shall ensure, or cause the EA and each IA to ensure, that no physical or economic displacement takes place in connection with the Project until: (a) compensation and other entitlements have been provided to affected people in accordance with the RP; and (b) a comprehensive income and livelihood restoration program has been established in accordance with the RP.	Being Complied	
Schedule IV Para 12	The Borrower shall ensure, or cause the EA and each IA to ensure, that the Project does not have any indigenous peoples impacts, within the meaning of the SPS. In the event that the Project does have any such impact, the Borrower shall take all steps required to ensure that the Project complies with the applicable laws and regulations of the Borrower and the State, and with the SPS.	Being Complied	
Schedule IV Para 13	The Borrower shall ensure, or cause the EA and each IA to ensure, that all necessary budgetary and human resources to fully implement the EMP and the RP as required, are made available on a timely basis.	Being Complied	
Schedule IV Para 14	The Borrower shall ensure, or cause the EA and each IA to ensure, that all bidding documents and contracts for Works contain provisions that require contractors to: (a) comply with the measures relevant to the contractor set forth in the IEE, the EMP and the RP (to the extent they concern impacts on affected people during construction), and any corrective or preventative actions set forth in a Safeguards Monitoring Report; (b) make available a budget for all such environmental and social measures; (c) provide the EA with written notice of any unanticipated environmental, resettlement or Indigenous peoples risks or impacts that arise during construction, implementation or operation of the Project that were not considered in the IEE, the EMP and the RP; (d) adequately record the condition of roads, agricultural land and other infrastructure prior to starting to transport materials and construction; and (e) reinstate pathways, other local infrastructure, and agricultural land to at least their pre-project condition upon the completion of construction.	Being Complied	

Schedule IV Para 15	The Borrower shall ensure, or cause the EA and each IA to ensure, the following: (a) submit semi-annual Safeguards Monitoring Reports to ADB until construction of the Works is complete and annual Safeguards Monitoring Reports to ADB during operation of the Works, and disclose relevant information from such reports to affected persons promptly upon submission; (b) if any unanticipated environmental and/or social risks and impacts arise during construction, implementation or operation of the Project that were not considered in the IEE, the EMP and the RP, promptly inform ADB of the occurrence of such risks or impacts, with detailed description of the event and proposed corrective action plan; and (c) report any breach of compliance with the measures and requirements set forth in the EMP or the RP promptly after becoming aware of such breach.	Being Complied	
---------------------	---	----------------	--

4.0 Compliance with Project Administration Manual (PAM)

Organization	Tasks	Compliance Status	Remarks
Executing Agency	GOU	Ongoing	NA
Implementing Agency	PTCUL	Ongoing	NA
Consultants	PISC	Shall be done as per ADB Norms .	LoA for appointment of PISC has been issued on dated 30.06.2025

5.0 Compliance to Entitlement Matrix

Summary of Compensation Payment

(1 January 2025 to 31 June 2025)

No.	Type of Loss	Affected persons	Entitlement	Details	Status
1.	Nil	Nil	Nil	Nil	Nil

6.0 Social Supervision

Training at all ADB sites are being conducted as per training module (attached in annexure –A) however some major trainings detail are as given below: -

Training	Number and Position of Participant/s	Location/s and Date/s	Remarks
Environment Safety Training	11 no Site workers and safety officer	132 kv Khatima-II S/S site,05.06.2025	Training related to waste management, water & dust management given at site.
Mock Drill - Medical Urgency	14 no Site workers and safety officer	132 kv Khatima-II S/S site,09.06.2025	Information regarding Do and don't in case of medical urgency .
Mock drill- flood	13 no Site workers and safety officer	132 kv Khatima-II S/S site,11.06.2025	Information regarding Do and don't in case of flood .
Tool Box talk	10 no Site workers and safety officer	132 kv S/S Dhaulakhera, 14.06.2025,21.05.2025	Training related to stone work handling, cutting and placing was given at site
Environment health & safety training	20 no Site workers and safety officer	132 kv S/S Dhaulakhera, 28.05.2025,08.03.2025	Training related to waste management, water, oil spillage control, air pollution & dust management given at site.
Health safety training	20 no Site workers and safety officer	132 kv S/S Dhaulakhera, 10.06.2025,23.05.2025	Use pf PPE, identification of danger at site and its mitigation, heavy machinery operation etc.
Fire safety training	15no Site workers and safety officer	132 kv S/S Dhaulakhera, 24.05.2025	Cause of fire ,use of fire Extinguisher training given.
Health safety & Environment training	16 no Site workers and safety officer	132 kv S/S Lohaghat 28.01.2025	Emergency preparedness, hazard identification, working at height and precaution related training given.
Tool Box Talk	10 no Site workers and safety officer	132 kv S/S Lohaghat 14.05.2025	Shuttering and de-shuttering work, steel cutting and binding safety.
Labour camp inspection	Safety officer	132 kv S/S Araghar ,dated 13.04.2025,28.04.2025	Waste removal system, toilet condition ,drinking water facility etc. checked.
Tool box Talk	20 no Site workers and safety officer	132 kv S/S Araghar ,dated 09.06.2025	Training related to safe transportation, handling, placing of Concerting work
Emergency & Safety training	15 no Site workers and safety officer	132 kv S/S Araghar ,dated 25.05.2025	EHS Policy, PPE, hazard identification and disposal, hot work(welding, cutting) precaution related training given.

Tool Box talk	16 no Site workers and safety officer	220 kV S/S Manglore S/S 13.06.2025	Training Given about material safe handling, placing and transportation.
SlipTrip&Fall Precaution	21 no Site workers and safety officer	220 kV S/S Manglore S/S 18.06.2025	Training regarding safe movement oat site without any fall at site.
Emergency plan training	10 no Site workers and safety officer	220 kV S/S Manglore S/S 25.06.2025	Training about preparedness against any emergency condition like fire, accident etc. at site.
Environment health & safety training	21 no Site workers and safety officer	220 kV Selaqui site,10.03.2025	Training covered maintaining proper health and hygiene among worker at site.
Safety training & Mock drill	05 no Site workers and safety officer	220 kV Selaqui site	Mock drill was prepared for fire break out at site.
Labor camp inspection	safety officer	220 kV Selaqui site	All labour camp inspected for waste water management, drinking water and good lighting system.

Site visit

Date	Type and Purpose of Visit	Location/s Visited	EA, IA, Consultant Staff Participating	Remarks
05.02.2025 07.03.2025 03.04.2025 06.05.2025 10.06.2025	Reviewing of social safeguard progress	220 kV Selaqui site, & Associated line	IA & Contractor safety staff	Consultant staff shall be included after formation of PISC
25.02.2025 07.03.2025 06.05.2025 10.06.2025	Reviewing of social safeguard progress	132 kv S/S Araghar & Associated line	IA & Contractor safety staff	Consultant staff shall be included after formation of PISC
05.02.2025 04.04.2025 07.05.2025 11.06.2025	Reviewing of social safeguard progress	220 kV Manglore & Associated line	IA & Contractor safety staff	Consultant staff shall be included after formation of PISC
30.01.2025 26.02.2025 07.04.2025 13.05.2025 17.06.2025	Reviewing of social safeguard progress	132 kV GIS S/s Dhaulakheda & associated Line	IA & Contractor safety staff	Consultant staff shall be included after formation of PISC.

31.01.2025 27.02.2025 08.04.2025 14.05.2025 17.06.2025	Reviewing of social safeguard progress	132 kV GIS Lohaghat & associated line	IA & Contractor safety staff	Consultant staff shall be included after formation of PISC
31.01.2025 27.02.2025 09.04.2025 15.05.2025 18.06.2025	Reviewing of social safeguard progress	132 kV GIS Khatima-II & associated line	IA & Contractor safety staff	Consultant staff shall be included after formation of PISC

7.0 Meaningful Consultation and Grievance Redress

Date	Format/Venue	Participants (Occupation, Male/Female)	Main Issues Raised
07.01.2025 10.02.2025 10.04.2025 23.05.2025 09.06.2025	220 kV Selaqui site & associated line	All Local community participant including male & female	All participants were satisfied
20.03.2025 18.04.2025 29.05.2025 28.06.2025	132 kV GIS S/s Araghar site & associated line	All Local community participant including male & female	All participants were satisfied
01.02.2025 01.03.2025 01.04.2025 27.05.2025 06.06.2025	132 kV GIS S/s Dhaulakheda site & associated line	All Local community participant including male & female	All participants were satisfied
01.01.2025 27.03.2025 01.05.2025 16.06.2025	132 kV GIS S/s Lohaghat & associated line	All Local community participant including male & female	All participants were satisfied
17.01.2025 14.02.2025 21.03.2025 13.04.2025 28.05.2025 30.06.2025	132 kV GIS S/s Khatima site & associated line	All Local community participant including male & female	All participants were satisfied
27.02.2025 21.03.2025 15.04.2025 01.05.2025	220 kV Manglore & associated line	All Local community participant including male & female	All participants were satisfied

Complainant/s or Affected Persons	Location/s and Date/s of Complaint	Description of Grievance/Complaint	Timeline*	Time-bound Corrective Action
(Nil)	Nil	Nil	Nil	Nil

* To be solved within 2 weeks

8.0 Conclusions and Recommendations

Non-compliance	Corrective Action to be Taken	Responsibility	Timeline	Budget
Constitution of PISC	Done	PIU	Completed	Approved
Translation of RP in Local language i.e. Hindi	Done	PIU	Completed	Approved
To ensure the grievance boxes and complain register in PMU, PIU and contractor office	Done	PIU, PMU and contractor	Completed	Approved
To conduct and ensure proper documentation of public consultation	Is being done at regular intervals	PIU and PISC	is being done	Approved

Summary of Grievance Registration till 31 June 2025

No	Title of complaint	Type of complaint	Date received	Name of plaintiff	Contact details of plaintiff	Summary of complaint	Action taken	Status of complaint / date	Notes/ comments
1.	NIL/No complain received till date								

APPENDIX (A) 1. GRC-3 Level Committee



पावर ट्रांसमिशन कारपोरेशन ऑफ उत्तराखण्ड लि०

(उत्तराखण्ड सरकार का उपक्रम)

प्रबन्ध निदेशक कार्यालय

विद्युत भवन, नजदीक-आई०एस०बी०टी० क्रासिंग, सहारनपुर रोड, माजरा, देहरादून-248002

दूरभाष नं० 0135-2642006 फैक्स नं० 0135&2643460 email:- md.ptcul@rediffmail.com

Letter no | 546 /MD/PTCUL/MD (GM)

Date: 23/04/2025

Office Memorandum

PTCUL being the implementation utility of Uttarakhand Climate Resilient Power System Development Project under Loan no 4402 funded by Asian Development Bank has to comply with Grievance Redressal Mechanism (GRM) as mentioned in Resettlement Plan and Initial Environment Examination.

In compliance of clause no V of RP plan, which state that "A 4-tier grievance redress mechanism shall be established to address concerns and grievances of affected persons and workers involved in this Project. Considering that the three (3) implementing agencies will implement different project sub-components and will likely receive complaints that may differ in nature and complexity, the Project will have GRM established separately at each implementing agency for their respective components. It will however, follow the same four tier structure with (i) Tier-1 at EPC Contractor/Division level; (ii) Tier-2 at PIU level; (iii) Tier-3 at PMU level (supported by PISC); and (iv) Tier-4 at the Energy Department of the Government of Uttarakhand (the executing agency) at the highest level."

Tier-3 (PMU) level Grievance Redressal Committee (GRC-3) comprising of following officers/members are hereby constituted as follows:-

Sr. No	Name of Work	Tier 3(GRC-3) PMU level Committee members
1.	220/33 kV GIS S/s, Selaqui and associated lines.	1. ADB Project Director & Principal Secretary, Energy, GoU
		2. Managing Director, PTCUL
		3. Smt. Amita Lohani, (A reputed Social Worker) Ramnagar, Nainital Former Vice President Uttarakhand State Commission for Women
		4. Er. Kamal Kant, Chief Engineer (Projects), Garhwal Zone as a Member Invitee.

Rajendra

मुख्यालय एवं पंजीकृत कार्यालय:- विद्युत भवन, नजदीक-आई०एस०बी०टी० क्रासिंग, सहारनपुर रोड, माजरा, देहरादून - 248002

दूरभाष नं० 0135-2646000 फैक्स नं० 0135-2643460 वेबसाइट www.ptcul.org

2.	220/132/33 kV AIS S/s Manglore & associated lines.	1. ADB Project Director & Principal Secretary, Energy, GoU
		2. Managing Director, PTCUL
		3. Smt. Amita Lohani, (A reputed Social worker) Ramnagar, Nainital Former Vice President Uttarakhand state Commission for Women
		4. Er. Kamal Kant, Chief Engineer (Projects), Garhwal Zone as a Member Invitee.
3	132/33 kV GIS S/s Araghar & associated Lines.	1. ADB Project Director & Principal Secretary, Energy, GoU
		2. Managing Director, PTCUL
		3. Smt. Amita Lohani, (A reputed Social worker) Ramnagar, Nainital Former Vice President Uttarakhand state Commission for Women
		4. Er. Kamal Kant, Chief Engineer (Projects), Garhwal Zone as a Member Invitee.
4	132/33 kv GIS S/s Dhaulakheda & associated Lines.	1. ADB Project Director & Principal Secretary, Energy, GoU
		2. Managing Director, PTCUL
		3. Smt. Amita Lohani, (A reputed Social worker) Ramnagar, Nainital Former Vice President Uttarakhand state Commission for Women
		4. Er. H.S. Hyanki, Chief Engineer (Projects), Kumaon zone as a Member Invitee.
5	132/33 kV S/s Khatima-II & associated Lines.	1. ADB Project Director & Principal Secretary, Energy, GoU
		2. Managing Director, PTCUL
		3. Smt. Amita Lohani, (A reputed Social worker) Ramnagar, Nainital Former Vice President Uttarakhand state Commission for Women
		4. Er. H.S. Hyanki, Chief Engineer (Projects), Kumaon Zone as a Member Invitee.

6	132/33 kV GIS S/s Lohaghat & associated line.	1. ADB Project Director & Principal Secretary, Energy, GoU
		2. Managing Director, PTCUL
		3. Smt. Amita Lohani, (A reputed Social worker) Ramnagar, Nainital Former Vice President Uttarakhand state Commission for Women,
		4. Er. H.S. Hyanki, Chief Engineer (Projects), Kumaon Zone as a Member Invitee.

The above committee shall resolve or dispose off all the grievances refer to Tier-3 (GRC-3) as per Grievance Redressal Mechanism (GRM) mentioned in Initial Environment Examination (IEE) and Resettlement Plan (RP) applicable for ADB funded project in the PTCUL.

(P.C. Dhyani)
Managing Director &
Additional Project Director

Letter no. SA/MD/PTCUL/MD (OM)

Date 23/04/2025

Copy forwarded to following

1. Principal Secretary (Energy) /Project Director, GoU Dehradun.
2. Mr. James Kolathanraj, Senior Energy Specialist, Asian Development Bank, Sector Group, Phillipnes.
3. Director (HR/Finance/Operations/Projects), PTCUL, Vidhyut Bhawan, Dehradun.
4. Smt. Amita Lohani, Near Bus Station, Ramnagar Nainital (Former Vice President, Uttarakhand State Commission for Women)
5. Chief Engineer (Project), Garhwal Zone, Pipalkoti.
6. Chief Engineer (Project- ADB), Kumaon Zone, Haldwani.

(P.C. Dhyani) 23/04/25
Managing Director &
Additional Project Director

Annexure-A 2.GRC-I & GRC-II Committee

	पावर ट्रांसमिशन कारपोरेशन ऑफ उत्तराखण्ड लि० (उत्तराखण्ड सरकार का उपक्रम) प्रबन्ध निदेशक कार्यालय
	विद्युत भवन, नजदीक-आईएसबीटी जंक्शन, सहारनपुर रोड, भाजरा, देहरादून-248002 दूरभाष नं० 0135-2642006 फैक्स नं० 0135&2643460 email:- md.ptcul@rediffmail.com
	Letter no /MD/PTCUL/
	Date

Office Memorandum

PTCUL, being the implementation utility of the project titled as "Uttarakhand Climate Resilient Power System Development Project Loan no 4402" funded by Asian development Bank has to comply with grievance redress mechanism (GRM) as mentioned in resettlement plan and Initial Environment Examination.

As per clause no V(E) of RP plan, which state that "A 4-tier grievance redress mechanism shall be established to address concerns and grievances of affected persons and workers involved in this Project. Considering that the three (3) implementing agencies will implement different project sub-components and will likely receive complaints that may differ in nature and complexity, the Project will have GRM established separately at each implementing agency for their respective components. It will however, follow the same four tier structure with (i) Tier-1 at EPC Contractor/Division level; (ii) Tier-2 at PIU level; (iii) Tier-3 at PMU level (supported by PISC); and (iv) Tier-4 at the Energy Department of the Government of Uttarakhand (the executing agency) at the highest level."

In compliance to above Division level Tier1(GRC-1) and PIU (PTCUL) level Tier2(GRC-2) committee comprising of following officers are hereby constituted: -

Package-1/Lot -1	Tier 1 (GRC -1) Division level Committee members	Tier 2(GRC - 2) PIU level Committee members
Lot-1-220/33 kV GIS S/S Selaqui and associated Line	1. Er.Vikalp Gautam Superintending Engineer (PI) Dehradun	1. Er.H.S. Hyanki Chief Engineer, (Project) ADB Haldwani
	2. Er.Deepak Kumar Executive Engineer (PI) Dehradun/Vikasnagar	2. Er.Vikalp Gautam Superintending Engineer (PI) Dehradun
	3. Er.Tikam Singh Chauhan Assistant Engineer (PI) Vikasnagar	3. Er.Deepak Kumar Executive Engineer (PI) Dehradun/Vikasnagar
	4. Project Manager authorized by EPC contractor	4. Representative from land revenue agricultural & Horticultural Department (Nominated by District Administration)
	5. Safe Guard Specialist from PISC	5. Elected representative of each Panchayat/Nagar Nigam including women Members (if woman member is available & in case elected member is woman) -(To be consulted during project implementation)

दस्तावेज एवं संबंधित कार्यवाही:- विद्युत भवन, नजदीक-आईएसबीटी जंक्शन, सहारनपुर रोड, भाजरा, देहरादून - 248002

दूरभाष नं० 0135-2642006 फैक्स नं० 0135-2643460 वेबसाइट www.ptcul.org

Package-2/Lot-2	Tier 1 (GRC-1) Division level Committee members	Tier 2(GRC-2) PIU level Committee members
132/33 kv GIS S/s Araghar 132 kv GIS S/s Dhaulakheda 132/33 kv S/s Khatima-II 132/33 kv S/s Lohaghat & Associated Line	1. Er. L.M. Bisht Superintending Engineer (PI) ADB Haldwani	1. Er. H.S. Hyanki Chief Engineer, (Project) ADB Haldwani
	2. Er. Deepak Kumar Executive Engineer(PI) Dehradun/Vikasnagar +Er. Sandeep Kaushik Executive Engineer (PI) Kashipur	2. Er.L.M. Bisht Superintending Engineer (PI) ADB Haldwani
	3. Er.Tikam Singh Chauhan Assistant Engineer(PI) Vikasnagar Er. Himanshu Vijay Singh Assistant Engineer (PI) Haldwani Er. Manoj Joshi Assistant Engineer Lohaghat	3. Er. Deepak Kumar Executive Engineer Dehradun/Vikasnagar (PI) Er. Sandeep Kaushik Executive Engineer (PI) Kashipur
	4. Project Manager authorized by EPC contractor	4. Representative from land revenue agricultural & Horticultural Department (Nominated by District Administration)
	5. Safe Guard Specialist from PISC	5. Elected representative of each Panchayat/Nagar Nigam including women members (if woman member is available & in case elected member is woman) (To be consulted during project implementation))
Package-3	Tier 1 (GRC -1) Division level Committee members	Tier 2(GRC - 2) PIU level Committee members
220/132/33 kv AIS S/s Manglore & Associated line	1. Er.A.K. Singh Superintending Engineer (PI) Roorkee	1. Er.H.S. Hyanki Chief Engineer, (Project) ADB Haldwani
	2. Er.Rakesh Kumar Executive Engineer PI Manglore	2. Er.A.K. Singh Superintending Engineer (PI) Roorkee
	3. Er. Anil Pal Assistant Engineer (PI) Padartha	3. Er.Rakesh Kumar Executive Engineer (PI) Manglore
	4. Project Manager authorized by EPC contractor	4. Representative from land revenue agricultural & Horticultural Department (Nominated by District Administration)

	5. Safe Guard Specialist from PISC	5. Elected representative of each Panchayat/Nagar Nigam including women members (if woman member is available & in case elected member is woman ((To be consulted during project implementation)))
--	------------------------------------	--

The above committee shall dispose all the grievances as per Grievance Redress Mechanism (GRM) mentioned in Initial Environment Examination (IEE) and Resettlement plan (RP) of PTCUL including compliance of other directions issued by ADB or other authorities concerned from time to time.

(P.C. Dhyani)
Managing Director &
Additional Project Director

Date 06/07/2024

Letter no 2024/MD/PTCUL MD(am)

Copy forwarded to following

1. Secretary energy /Project director, GOU Dehradun
2. District Magistrate -Dehradun/Nainital/Udhamsingh Nagar/Champawat
3. Mr. James Kolathanraj ,Senior Energy Specialist,Asian development Bank ,Sector Group,Phillipnes
4. Director (HR/Finance/Operations) PTCUL Vidhyut Bhawan Dehradun
5. M/s Flowmore Ltd plot no 2068/69 karol Bhagh 38 New Delhi
6. Transglobal Power Limited,1321/A, 15th cross, Girinagar, 2nd stage Bangalore
7. Official concerned.

(P.C. Dhyani)
Managing Director &
Additional Project Director

Annexure-A 3. LOA PISC



पावर ट्रांसमिशन कारपोरेशन ऑफ उत्तराखण्ड लि०

(उत्तराखण्ड सरकार का उपक्रम)

CIN:-U40101UR2004SGC028675

अधीक्षण अभियन्ता (क्रय एवं अनुबन्ध-।।) कार्यालय

विद्युत भवन, नजदीक-आई०एस०बी०टी० क्रॉसिंग, सहारनपुर रोड, माजरा, देहरादून-248002

दूरभाष नं० 0135-2131520, email:- dgm_candp@rediffmail.com,

No.: S36 /SE(C&P-II)/PTCUL/ PISC

Dated: 30.06.2025

Medhaj Techno Concept Pvt. Ltd., India (MTCPL) in Joint Venture with Nippon Koei Co., Ltd., Japan (NK) and in Association with Nippon Koei India Pvt. Ltd., India (NKI)

Medhaj Tower, CP-150, Sector-D1,

Power House Chauraha,

Aashiana Kanpur Road, Lucknow-226012, U.P. (India)

Phone :+91-522-2425912, Fax No.: +91-522-2425913

E-mail: mtcpl@medhaj.com, siddharth.mehta@medhaj.com, gaurav.lohani@medhaj.com

Subject:- Letter of Acceptance (LOA) against RFP No.: C&P-II/ADB/PTCUL/2023-2024/PISC for "Selection of Consulting Services for: PISC-01 Project Implementation Support Consultant (PISC) for Power Transmission Corporation of Uttarakhand Ltd." (PTCUL).

Dear Sir,

This is to notify you that your Request for Proposal (RFP) dated [22 October 2024] for "Selection of Consulting Services for: PISC-01 Project Implementation Support Consultant (PISC) for Power Transmission Corporation of Uttarakhand Ltd." (PTCUL) against RFP No.: C&P-II/ADB/PTCUL/2023-2024/PISC for the Contract Price in the aggregate of Rs. 8,06,50,000.00 [Rupees Eight Crore Six Lakh Fifty Thousand only] (Excluding GST) [INR] and Rs. 9,51,67,000.00 [Rupees Nine Crore Fifty One Lakh Sixty Seven Thousand only] (Including GST@ 18%) [INR], as corrected and modified in accordance with the Instructions to Consultants (ITC) including Data Sheet (DS) is hereby accepted by our Agency.

You are requested to furnish the Consultant Performance Guarantee @ 10% of Contract Value including GST in favour of Managing Director, Power Transmission Corporation of Uttarakhand Limited, Vidyut Bhawan, Near ISBT Crossing, Saharanpur Road, Majra, Dehradun within 07 days in accordance with the Conditions of RFP/Negotiation, using for that purpose one of the Consultant Performance Guarantee (CPG) form is attached.

Encl: Consultant Performance Guarantee (CPG) format.

Thanking You,

Accepted & Signed

Medhaj Techno Concept Pvt. Ltd., India (MTCPL) in Joint Venture with Nippon Koei Co., Ltd., Japan (NK) and in Association with Nippon Koei India Pvt. Ltd., India (NKI)

Yours Sincerely

(Santosh Kumar)
Superintending Engineer(C&P-II)

No.: S36 /SE(C&P-II)/PTCUL/ PISC

Dated: 30.06.2025

Copy forwarded to following for information:

1. PS to Managing Director, PTCUL, Dehradun for kind information of MD, PTCUL
2. Director (Operation), PTCUL, Dehradun.
3. Chief Engineer (Projects), Garhwal Zone, PTCUL, Pipalkoti.
4. Chief Engineer (Projects-ADB), Kumaon Zone, PTCUL, Haldwani.
5. Chief Engineer (C&P), PTCUL, Dehradun.
6. General Manager (Finance), PTCUL, Dehradun.
7. Superintending Engineer (PMU-ADB) & Nodal Officer for ADB projects, PTCUL, Dehradun will be Nodal Officer of PISC.
8. Superintending Engineer (PI), PTCUL, Dehradun/ Roorkee/ Haldwani/Kashipur.
9. Superintending Engineer (Engg.-S/s)/(Engg.-Line)/(QA/QC), PTCUL, Dehradun.

(Santosh Kumar)
Superintending Engineer(C&P-II)

मुख्यालय एवंपंजीकृत कार्यालय-विद्युतभवन, नजदीक-आई०एस०बी०टी० क्रॉसिंग, सहारनपुररोड, माजरा, देहरादून- 248002
कार्यालयईआईसी नं०U40101UR2004SGC028675 दूरभाष नं० 0135-2848000 फैक्स नं० 0135-2843480 वेबसाइटwww.ptcul.org

APPENDIX 4 Site Photographs

132 kV S/S Araghar



Control Room



132 kv GIS S/S Dhaulakheda



Control Room



132 kV GIS S/S Lohaghat



Control Room



220 kv GIS S/S Selaqui



220 kv GIS Hall



132 kV GIS S/S Khatima



Control Room



220 kV AIS S/S manglore
Control room



Switchyard constrction



Training Schedule for ADB Projects

Sr.No	TRAINING PROGRAM	SCHEDULE
1	Safety Induction Training (For New Worker)	Every month
2	Tool Box Training	Daily
3	Environment Training	Every Month
4	Safety Training	Every 15 Days
5	Social &Public Consultations Meeting	Every Month
6	Fire Training	Every Month
7	Labor Camp , Equipment Inspection & Housekeeping Program/Training	Every 15 Days
8	Health & hygiene Training	Every Month
9	Emergency & Mock drill Training (Medical urgency ,earthquake,fire,flood, electric shock etc.)	Every 15 Days

Public consultation at 132 kV GIS S/s Dhaulakheda site on dated 01.02.2025

PUBLIC CONSULTATION

Rehabilitation and Up-gradation of promoting public private partnership in power transmission Corporation of Uttarakhand Limited (PTCUL)

Name of Project	132/33 KV line Dhaulakheda
Location of Public Consultation	Near 33 KV UPCL permission
Date of Public Consultation	01/02/2025

Attendance and Signature Sheet of Participant:-

S. No	Name of Person	Occupation	Sex/Age	Address	Signature	Mo. No.
1.	Dharmendra	Farmer	M	Bhachipur	[Signature]	
2.	Ram Sevak	Farmer	M	Dhaulakheda	[Signature]	
3.	Gopal	Farmer	M	Bhachipur	[Signature]	7535005104
4.	Ritesh Kumar	Helper	M	Haldwani	[Signature]	
5.	Narash	labour	M	Dhaulakheda	[Signature]	
6.	Neharaj	Student	M	Bhachipur	[Signature]	9256157634
7.	Ravi Kumar	Engineer	M	Haldwani	[Signature]	
8.	Raju	Labour	M	Dhaulakheda	[Signature]	
9.						
10.						

Discussion With Participants:-

There are no pollution made by construction Activity till now company following all The safety measures for health safety and Environment.

All the company employee labour are live with health relation with villages local community and All over

Seen

[Signature]
AEIDP,
PTCUL

[Signature]
Dheer Singh
Safety officer
(Manager Projects)



Public consultation at 132 kV GIS S/s Dhaulakheda site on dated 01.03.2025

PUBLIC CONSULTATION

Rehabilitation and Up-gradation of promoting public private partnership in power transmission
Corporation of Uttarakhand Limited (PTCUL)

Name of Project	132/33 KV GIS S/s Dhaulakheda
Location of Public Consultation	Near Barchi pur Dhaulakheda
Date of Public Consultation	01/03/25

Attendance and Signature Sheet of Participant:-

S. No	Name of Person	Occupation	Sex/Age	Address	Signature
1.	Faizan	Farmer	m	Barchi Pur	[Signature]
2.	Jardul Singh	Farmer	m	Barchi pur	[Signature]
3.	Pankaj Dhabhagat	DRIVER	m	Matahala Jui pur	[Signature]
4.	Desh Khandwal	CHOKLA SUDI	m	Matahala	[Signature]
5.	NAVIN JAIN	SHOPKEEPER	m	Matahala Jui pur	[Signature]
6.	Singh Khali	Architect	m	Jailpur KHEEMA	[Signature]
7.					
8.					
9.					
10.					

9758131059
9837152636
9927405100
9837453670
8218951987
9897836963

Discussion With Participants:-

- * 01/03/2025 को साविकानिक बैठक में निम्नलिखित बिंदुओं पर चर्चा की गई कि नए बिजनेस सबस्टेशन के निर्माण के दौरान कोई प्रदूषण नहीं होगा
- * वोल्टेज की समस्या कम होगी
- * नए बिजनेस निर्माण के लिए किसी भी प्रकार का वायु प्रदूषण नहीं पैदा किया जाएगा

Dheeraj
Safety Officer



Public consultation at 132 kV GIS S/s Dhaulakheda site on dated 01.04.2025

PUBLIC CONSULTATION

Rehabilitation and Up-gradation of promoting public private partnership in power transmission
Corporation of Uttarakhand Limited (PTCUL)

Name of Project	132/33 kV lines S/s Dhaulakheda
Location of Public Consultation	Village - Bachipur
Date of Public Consultation	01/04/25

Attendance and Signature Sheet of Participant:-

S. No	Name of Person	Occupation	Sex/Age	Address	Signature	
1.	Ravindra	Farmer	M	Bachipur	[Signature]	9411594615
2.	Lala Ram	Helper	M	"	[Signature]	9759722144
3.	chaube	driver	M	"	[Signature]	
4.	Abhishek	Student	M	"	[Signature]	
5.	Pankaj	shopkeeper	M	"	[Signature]	800654889
6.	Ugagan		M	"	[Signature]	8493924969
7.	Bhawal Singh		M	"	[Signature]	97550
8.						
9.						
10.						

Discussion With Participants:-

- * अब तक निर्माण गतिविधि से कोई प्रदूषण नहीं हुआ है; कंपनी स्वास्थ्य और सुरक्षा पर्यावरण के लिए सभी सुरक्षा उपायों का पालन करती है।
- * कंपनी के सभी कर्मचारी / श्रमिक ग्रामीणों / स्थानीय समुदाय के साथ अच्छे संबंध में रहते हैं। तथा उनकी स्थानीय संस्कृति का पालन और सम्मान करते हैं।
- * स्थानीय ग्रामीणों ने जीआईएस सबस्टेशन के निर्माण में सहयोग का वादा किया है।

Dheeraj
Safety Officer










PUBLIC CONSULTATION

Rehabilitation and Up-gradation of promoting public private partnership in power transmission
Corporation of Uttarakhand Limited (PTCUL)


Name of Project	132/33 KV GIS S/s Dhaulakheda
Location of Public Consultation	Village - Bachipur
Date of Public Consultation	07/05/25

Attendance and Signature Sheet of Participant:-

S. No	Name of Person	Occupation	Sex/Age	Address	Signature
1.	UDIT	HELP	M/37	VIII. Bachipur, HLD	 9927050251
2.	Rakesh	Helper	male	Bachipur	
3.	Suraj	Helper	male	"	
4.	Ankit	Farmer	male	"	
5.		Farmer	male	"	 9411162780
6.	Raizan		male	"	 9158131059
7.	Arshad		male	"	 9520551559
8.	Ran Kaur	Shopkeeper	male	"	 8006578822
9.					
10.					

Discussion With Participants:-

- * कंपनी/विभाग ने 132/33 केवी जीआईएस सबस्टेशन की सुविधा उपलब्ध कराने के लिए सभी लोगों से चर्चा की है।
- * अब तक निर्माण गतिविधि से कोई प्रदूषण नहीं हुआ है। कंपनी स्वास्थ्य और सुरक्षा और पर्यावरण के लिए सभी सुरक्षा उपायों का पालन करती है।
- * स्थानीय ग्राहकों ने जीआईएस सबस्टेशन के निर्माण में सहयोग का वादा किया है।

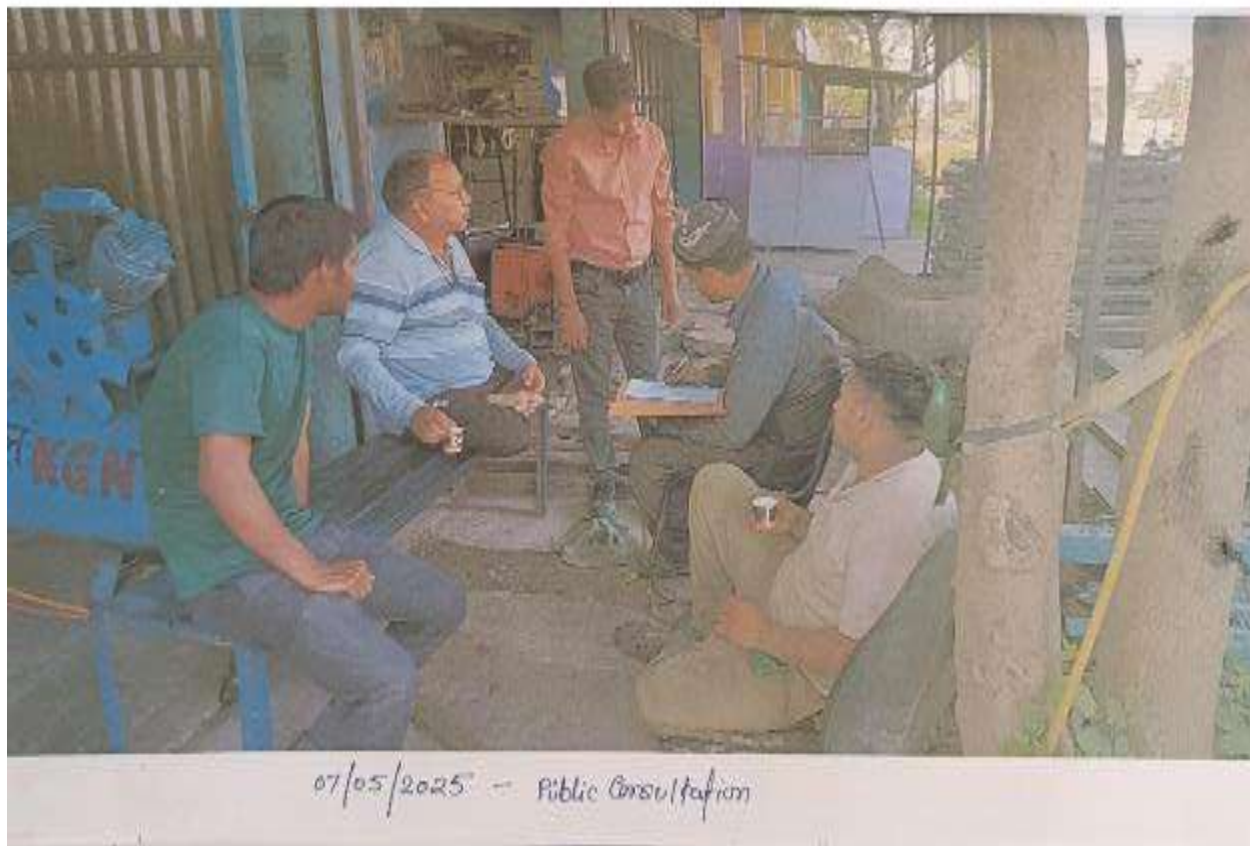

Public consultation at 132 kV GIS S/s Dhaulakheda site on dated 06.06.2025



PUBLIC CONSULTATION FORM



**Uttarakhand Climate Resilient Power System Development Project
(PTCUL)**

Funded By Asian Development Bank, (Loan no. :- 4402)

Name Of Project	Construction of 132/33 kV GIS Substation Dhaulakheda
Location Of Public Consultation	Padlipur, Bachchipur village
Date Of Public Consultation	06/06/2025

Topics Discussed with Participants: -

- परियोजना अवलोकन: बिजली सबस्टेशन का उद्देश्य, स्थान और लाभ।
- समयरेखा: अपेक्षित निर्माण अवधि और कार्य घंटे।
- संभावित प्रभाव: शोर, धूल, यातायात व्यवधान और पर्यावरण सुरक्षा उपाय।
- शमन उपाय: असुविधाओं को कम करने के लिए कदम (जैसे, अवरोध, धूल नियंत्रण)
- रोजगार के अवसर: अकुशल/कुशल श्रमिकों के लिए स्थानीय भर्ती प्राथमिकताएँ।
- शिकायत निवारण: शिकायत कैसे दर्ज करें (जीआरएम अधिकारियों के संपर्क विवरण)
- प्रश्नोत्तर सत्र: भूमि उपयोग, सुरक्षा और दीर्घकालिक लाभों पर प्रश्नों को संबोधित किया गया।

Attendance and Signature Sheet of Participants: -

S.no	Name Of Person	Occupation	Mob. No.	Address	Signature
1	रविन्द्र जेठवा	डुकान	8477891025	पादपूर	
2	दिनेश जोशी	डुकानदार	9410714475	पक्षीपुर	
3	अरुण	डुकानदार	721744266	पादपूर	
4	मनोज	डुकानदार	7505482525	पक्षीपुर	
5	रवीश्वर नन्द	डुकानदार	9557359885	पादपूर	
6	अरुण सिंह	डुकानदार	8909947284	पादपूर	
7					
8					



Handwritten signature
JECOP

PUBLIC CONSULTATION



Signature
TEJOP

PUBLIC CONSULTATION

"Uttarakhand Climate Resilient Power system Development Project"

NAME OF PROJECT	132/33 KV GIS
LOCATION OF CONSULTATION	Dalsli, Lohaghat
DATE	01-01-2025

Attendance Sheet of Participant:-

S.N	NAME OF PERSON	OCCUPATION	SEX/AGE	ADDRESS	SIGNATURE	CONTACT NO.
1	Deepak Rai	Business	M/35	chaurighat	Deem	9084040335
2	Hemant Rai	Business	M/45	chaurighat	Hemant	976104211
3	Naresh	Dofner	M/25	Dalsli	NR	7251946511
4	Gudlu Ko.	Worker	M/30	Dalsli	GS	9931160192
5	Ayush Mehta	Business	M/22	Kaligaon	3-12/5	8077154368

DISCUSS WITH PARTICIPANT:-

- 1- There are no pollution made by Construction Activity till Now.
- 2- Company/Department Representative discussed all the benefits of under Construction substation.
- 3- The Local Villager Promised to Cooperate with us.

Surendra Singh
01/01/2025

anil
1-1-2025



Public consultation at 132 kV GIS S/s Lohaghat site on dated 27.03.2025

PUBLIC CONSULTATION

"Uttarakhand Climate Resilient Power system Development Project"

NAME OF PROJECT	132/33 KV GIS Lohaghat
LOCATION OF CONSULTATION	Dafsy village, Lohaghat
DATE	27/03/2025

Attendance Sheet of Participant:-

S.N	NAME OF PERSON	OCCUPATION	SEX/AGE	ADDRESS	SIGNATURE	CONTACT NO.
1	Jeevan Ram	किसान	m/41	डेहली	[Signature]	8171812242
2	Naregh Kr.	किसान	m/54	डेहली	[Signature]	8171812282
3	Krishna Prasad	किसान	m/52	डेहली	[Signature]	
4	Mukesh Kr.	किसान	m/38	डेहली	[Signature]	
5	Prem Ram	किसान	m/74	डेहली		
6	Dipa Devi	गृहणी	F/35	डेहली	[Signature]	
7	Kiran Devi	गृहणी	F/33	डेहली	[Signature]	

DISCUSS WITH PARTICIPANT:-

- कार्यदात्री संस्था / बिजाज के लोगो ने गांव सभी डेहली के लोगों को 132/33 के वी. बिजुत उपस्थान के फायदे बताये।
- गांववासी लोगो ने बताया कि कार्य क्षेत्र से कुछ खी कुत पर पानी का डिडकाव दिन के दो बार जिया जा रहा है परंतु शुष्क दिनों में ज्यादा बार डिडकाव किया जा रहा है ज्यादा धुल न उड़े।
- गांववासी ने बताया कि अभी खेतों की कंपनी का कार्यवाही कर रहे हैं वो बहुत जिल/मिलाकी है और स्थानीय लोगो का सम्मान नहीं है।



PUBLIC CONSULTATION WITH LOCAL VILLAGERS

132/33 KV GIS LOHAGHAT



Date:- 27/03/25



PUBLIC CONSULTATION

"Uttarakhand Climate Resilient Power system Development Project"

NAME OF PROJECT	132/33 kV GIS S/s Lohaghat
LOCATION OF CONSULTATION	Lohaghat, Dairly, mailkuna
DATE	01/05/2025

Attendance Sheet of Participant:-

S.N	NAME OF PERSON	OCCUPATION	SEX/AGE	ADDRESS	SIGNATURE	CONTACT NO.
1	Puran Chandra	Retired (Municipality)	M/71	Chauri Rai	[Signature]	9627590671
2	Mohan Rai	Farmer	M/60	Chauri Rai	[Signature]	8194067748
3	Vinod Kauri	Driver	M/42	Chauri Rai	[Signature]	9149273695
4	Anand Singh	Driver	M/32	Chauri Rai	[Signature]	7830793504
5	Gurpaul	Driver	M/28	Lohaghat	[Signature]	7525021678
6	Zeehan	Worker	M/30	Lohaghat	[Signature]	9520560336



DISCUSS WITH PARTICIPANT:-

कार्यवाही संस्था / विभाग को गांवियों ने बताया कि अभी तक जो कंपनी का कार्यवाही / आगिक कार्य कर रहे हैं वो बहुत कम भेदाप के साथ रह रहे हैं। और स्थानीय लोगों का सम्मान करते हैं। गांवियों ने कार्य क्षेत्र से ऊँची धुल पानी का दिक्रम दिन में दो बार किया जा रहा है। ताकि ज्यादा धुल न उड़े। कार्यवाही संस्था / विभाग के लोगों ने गांवियों को 132/33 के वी उपस्थान के बारे में बताया। गांवियों ने बताया कि 132/33 के वी विस्तृत उपस्थान का कार्य बहुत तेजी से चल रहा है।

Date :- 01/05/2025
Time :- 8:00 AM



PUBLIC CONSULTATION AT 132/33 KV GIS LOHAGHAT



[Signature]
JE (P)

Public consultation at 132 kV GIS S/s Lohaghat site on dated 16.06.2025





PUBLIC CONSULTATION FORM

Uttarakhand Climate Resilient Power System Development Project (PTCUL)

Funded By Asian Development Bank, (Loan no. :- 4402)

Name Of Project	Construction of 132/33 kV GIS Substation lohaghat
Location Of Public Consultation	Lohaghat, Champawat
Date Of Public Consultation	16/06/2025

Topics Discussed with Participants: -

- परियोजना अवलोकन: बिजली सबस्टेशन का उद्देश्य, स्थान और लाभ।
- समयरेखा: अपेक्षित निर्माण अवधि और कार्य घंटे।
- संभावित प्रभाव: शोर, धूल, यातायात व्यवधान और पर्यावरण सुरक्षा उपाय।
- शमन उपाय: असुविधाओं को कम करने के लिए कदम (जैसे, अवरोध, धूल नियंत्रण)।
- रोजगार के अवसर: अकुशल/कुशल श्रमिकों के लिए स्थानीय भर्ती प्राथमिकताएँ।
- शिकायत निवारण: शिकायत कैसे दर्ज करें (जीआरएम अधिकारियों के संपर्क विवरण)।
- प्रश्नोत्तर सत्र: भूमि उपयोग, सुरक्षा और दीर्घकालिक लाभों पर प्रश्नों को संबोधित किया गया।


Attendance and Signature Sheet of Participants: -

S.no	Name Of Person	Occupation	Mob. No.	Address	Signature
1	Nitesh Rai	Student	8958111883	Lohaghat	[Signature]
2	Vivek Pyari	Student		Lohaghat	[Signature]
3	Pankaj Rai	Shopkeeper		Kaligaran	[Signature]
4	Jeevan Ram	Farmer	8171812292	Dulsly	[Signature]
5	Mohun Rai	Farmer	8174067748	Chauri Rai	[Signature]
6	Memant Rai	Farmer	9761042111	Chauri Rai	[Signature]
7					
8					
9					
10					





**PUBLIC CONSULTATION AT DAISLY VILLAGE OF
LOHAGHAT 16/06/2025**

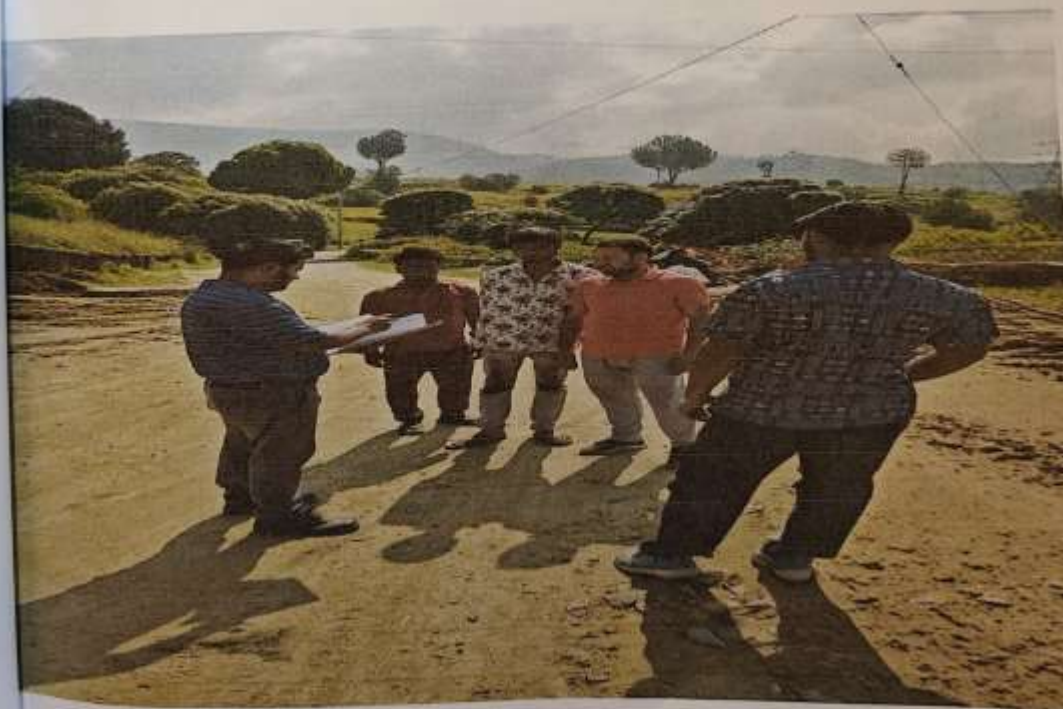

Public consultation at 132 kV GIS S/s Khatima site on dated 17.01.2025



PUBLIC CONSULTATION



Rehabilitation and Up-gradation of promoting public private partnership in power transmission Corporation of Uttarakhand Limited (PTCUL)

Name of Project	132/23 KV GIS Substation, Khatima
Location of Public Consultation	Khatima D. (U.S. Nagar)
Date of Public Consultation	17/01/2025


Attendance and Signature Sheet of Participant:-

S. No	Name of Person	Occupation	Sex/Age	Address	Signature
1.	Raja Devi	Housewife	26	Paladga.	[Signature]
2.	Prakash Singh	Housewife	56	"	[Signature]
3.	Amrinder Singh	Housewife	34	"	[Signature]
4.	Dan Singh	Farmer	57	Paladga	[Signature]
5.	Amul Singh	Businessman	40	"	[Signature]
6.	Raja Gaudan	"	26	"	[Signature]
7.	Darla Gaudan	"	20	Paladga	[Signature]
8.	Suresh Choudhary	"	32	"	[Signature]
9.	Arvind Vishwakarma	"	28	"	[Signature]
10.	L. K. Gaudan	"	91	"	[Signature]


Discussion With Participants:-

Public consultation meeting conduct on 17/01/2025 and following point discuss.


- * There will be no wastage material dump in near by area.
- * There will be no any pollution create during building construction.
- * There will no dirty water dropping at near by Colony Area
- * All the Company Employee are Live with Healthy Relation with Villagers and Local Community.




Manish Pathak
for Flowmore Ltd.



[Name]
for Flowmore Ltd.



[Name]
for Flowmore Ltd.



[Name]
for Flowmore Ltd.



Public consultation at 132 kV GIS S/s Khatima site on dated 14.02.2025



PUBLIC CONSULTATION

Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no: - 4402)



Name of Project	132/33 kV GIS Substation, Khatima
Location of Public Consultation	Khatima
Date of Public Consultation	14/02/25

Discussion With Participants:-


उत्तराखण्ड के लोगों से पानी के निकासी की कमी के बारे में चर्चा की गई।

(i) वर्षा न. 12 के तहत अत्यधिक पानी तथा खरीब का पानी को निकासी एस.एस. करण्ड है इसके अलावा इसे बिलाल है सभी बाढ़ी वर क्षेत्र से पानी फूट रहा हुआ है इसी निकासी का इलाज नाला बनकर समाधान किया जाय।

(ii) नए निर्मित बिजलीघर से काफी बहुत सारा पानी है जिससे हमें कोई आपत्ति नहीं है परन्तु इसे का पानी के निकासी का फल से अन्य समाधान किया जाय।

Attendance and Signature Sheet of Participant:-

S. No.	Name of Person	Occupation	Mob. No.	Address	Signature
1.	डॉ. न. सिंह	गणतंत्र प्रमुख	7133 173018	क.प.प.प.	[Signature]
2.	गोपी कृष्ण	ग्रामीण	9251926166	प.प.प.प.	[Signature]
3.	विजय सिंह	कृषक	8860088798	.	[Signature]
4.					
5.					
6.					
7.					
8.					
9.					
10.					







Public consultation at 132 kV GIS S/s Khatima site on dated 21.03.2025



PUBLIC CONSULTATION

**Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no: - 4402)**

Name of Project	132/33 kV GIS Substation, Khatima
Location of Public Consultation	Khatima (Saurik Colony)
Date of Public Consultation	21/3/25

Discussion With Participants:-

- ① गांव के लिए ऐसे मय निर्माण कार्य से हमें कोई भयभीत नहीं है किन्तु हमारे घरों के पानी के निचालने के लिए हमारे नाला बनाकर पानी के निचाल का समाधान दिया जाए
- ② कम्पनी के द्वारा किया गया कार्य सरासरीय है
- ③ कम्पनी के द्वारा किया गये निर्माण कार्य से किसी प्रकार की प्रदुषण नहीं फैल रहा है
- ④ कम्पनी प्रदुषण नियंत्रण के (जल, वायु, दूध) उपाय समय-समय से कर रहा है

Attendance and Signature Sheet of Participant:-

S.No.	Name of Person	Occupation	Mob. No.	Address	Signature
1.	Karan Singh	Student	9389604044	Rikdrye	Birb.
2.	Jankaran Jethi	"	6396489831	"	Jankaran
3.	Nitin Singh	"	7505348126	"	Nitin
4.	Meena Kaulpal	Housewife	7017096047	"	Mk
5.	Durga Devi	"	9359495444	"	रिखा देवी
6.	Manish			"	
7.	Kamlesh			"	
8.					
9.					
10.					



Public consultation at 132 kV GIS S/s Khatima site on dated 13.04.2025




PUBLIC CONSULTATION

Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no: - 4402)

Name of Project	132/33 kV GIS Substation, Khatima
Location of Public Consultation	Khatima - II (P.S./Panchayat)
Date of Public Consultation	13/04/2025

Discussion With Participants:-

* जब निर्माण गिजली प्कार निर्माण कार्य बहुत अच्छे से हो रहा है। जो जिसे हम बहुत खुशी है। प्रकृ गन्धेश्वर के बीच से जो गुप्तगुप्ती गाला है पिल्ले-कालोरी का फनी निकलता है उसे म्थामी खाना कि कृपा करे पिल्ले को खाने जाने म्थामी के पिल्ले म्थामी कि किल्ले को खाना न करे पडे।

* कम्पनी के सभी कर्मचारी धान्दे खाना के हैं और ये पर्वकल के खान्दे खाने के किन्ने हर सम्भव प्रमाण खाना-खाना पर करके रखे हैं।

Attendance and Signature Sheet of Participant:-

S.No.	Name of Person	Occupation	Mob. No.	Address	Signature
1.	श्रीमती म्थामी	म्थामी	930002660	गाँव नं. 19	[Signature]
2.	श्रीमती म्थामी	म्थामी	930002663	पञ्चरंगा	[Signature]
3.	श्रीमती म्थामी	म्थामी	930002664	"	[Signature]
4.	श्रीमती म्थामी	म्थामी	930002665	"	[Signature]
5.	श्रीमती म्थामी	म्थामी	930002666	"	[Signature]
6.	श्रीमती म्थामी	म्थामी	930002667	"	[Signature]
7.					
8.					
9.					
10.					







Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no: - 4402)

Name of Project	132/33 kV GIS Substation, Khatima-II
Location of Public Consultation	Shankar Durg and Patancha
Date of Public Consultation	20/05/2015

[illegible]

S.No.	Name of Person	Occupation	Mob. No.	Address	Signature
1.	Diamond Jodit	At. si Police Department	8496836531	Police station	
2.	Pandurangam Srinivas	Manager	9927976109	Thankkudga Therukun	
3.	Kamesh Babu	At. si	9927976109	Therukun	
4.	Abdulkarim	Manager	9927976109	Therukun	
5.	Abdulkarim	Manager	9927976109	Therukun	
6.	Abdulkarim	Manager	9927976109	Therukun	
7.	Abdulkarim	Manager	9927976109	Therukun	
8.	Abdulkarim	Manager	9927976109	Therukun	
9.	Abdulkarim	Manager	9927976109	Therukun	
10.	Abdulkarim	Manager	9927976109	Therukun	

$$-j\omega C \cdot R$$

Handwritten signatures and stamps:


- Signature: *James J. [illegible]*
- Signature: *Project Manager*
- Signature: *Kamal*
- Signature: *Project Manager*
- Stamp: *ELMISTO LTD.*
- Stamp: *Director Office*

Public Consultation at 132/92 KV GIS & n transmission line
dated: 28/09/2024

A photograph showing three men in an indoor setting. One man in a khaki uniform is seated at a table covered with various documents and maps, writing. Two other men, one in a light blue shirt and one in a white shirt, are standing and looking at the documents.

A photograph of two men standing outdoors on a paved area. The man on the left, wearing a dark shirt and blue pants, is holding a document and pointing at it. The man on the right, wearing a light blue shirt and jeans, is looking at the document.

A photograph of a group of five people standing outdoors on a dirt path. From left to right: a man in a blue shirt and grey pants, a man in a dark shirt and black pants, a woman in a light blue shirt and black pants with a yellow shawl, a man in a white shirt and black pants, and a man in a light blue shirt and grey pants holding a green folder.

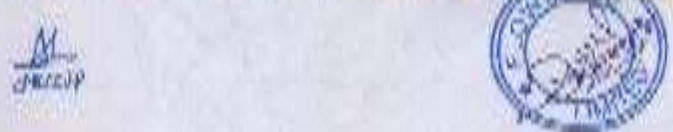A handwritten signature in blue ink and a circular official stamp of the Government of Karnataka, Department of Public Works, Bangalore. The stamp contains the text "GOVERNMENT OF KARNATAKA", "DEPARTMENT OF PUBLIC WORKS", and "BANGALORE".

Public consultation at 132 kV GIS S/s Araghar site on dated 20.03.2025



PUBLIC CONSULTATION

Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no: - 4402)

Name of Project	132/33 kV GIS Substation, Araghar
Location of Public Consultation	Araghar
Date of Public Consultation	20/03/25

Discussion with Participants:-

- * अब तक निर्माण गतिविधि से कोई प्रभाव नहीं हुआ है, केवल स्वास्थ्य और सुरक्षा और पर्यावरण के लिए सभी सुरक्षा उपकरणों का प्रयोग करती हैं।
- * कंपनी के सभी कार्यकारी/प्रबंधक/स्थानीय समुदाय के साथ अच्छे संबंधों में हैं तथा उनकी स्थानीय संस्कृति का फोकस और सम्मान करते हैं।
- * कंपनी/विभाग से 132/33 केवी जी आर्किव्स सबस्टेशन की सुरक्षा उपलब्ध कराने के लिए सभी लोगों से वचने लिए हैं।
- * स्थानीय बांधों से जी आर्किव्स सबस्टेशन के निर्माण से स्थानीयता का बचो रखा है।

Attendance and Signature Sheet of Participant:-

S.No.	Name of Person	Occupation	Mob. No	Address	Signature
1.	Arvind Kauri	Job Carer	9760 888181	Hydel Colony	[Signature]
2.	Parthiv Chandra	PR L. Carer	8756 764868	Hydel Colony	[Signature]
3.	Rakesh Kauri	DRD, UPL	9760 888181	Hydel Colony	[Signature]
4.	Rakesh Arora	DRD, UPL	9897161126	Hydel Colony	[Signature]
5.	Arvi Arora	UPL	9893882733	Hydel Colony	[Signature]
6.	Krishan Tiwari	Business	7973720740	Model Colony	[Signature]
7.	Navin Tiwari	Business	8702269411	Model Colony	[Signature]
8.					
9.					
10.					


[Handwritten signature]

*Kishan Chandra
 Incharge
 Flowman - 100.*

*Aravind Kauri
 Safety Officer
 Flowmore Ltd.*



Public consultation at 132 kV GIS S/s Araghar site on dated 18.04.2025



PUBLIC CONSULTATION

**Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no: - 4402)**

Name of Project	132/33 kV GIS Substation, Araghar
Location of Public Consultation	Araghar
Date of Public Consultation	18/04/25

Discussion with Participants:-

- * ओर लोक विरोध गतिविधि से कोई प्रभाव नहीं हुआ है, कंपनी स्वस्थ और सुरक्षा और पर्यावरण के लिए सभी सुरक्षा उपायों का पालन करती है,
- * कंपनी के सभी कर्मचारी / श्रमिकों / भूतस्थ / स्थानीय समुदाय के साथ अच्छे संबंध हैं और हैं तथा उनकी स्थानीय संस्कृति का पालन और सम्मान करते हैं,
- * कंपनी / विभाग ने 132/33 केवी एंडी अडिस्ट सबस्टेशन को सुरक्षा और पर्यावरण के लिए सभी लोगों से चर्चा की है,
- * स्थानीय श्रमिकों ने एंडी अडिस्ट सबस्टेशन के निर्माण से सहयोग कर काम किया है,

Attendance and Signature Sheet of Participant:

S.No.	Name of Person	Occupation	Mob. No.	Address	Signature
1.	Pragati Singh	shop	6692333879	24/1 Model Colony	Kul
2.	Kishan Singh	house	7983320740	24/1 Model Colony	Kul
3.	Tilak Singh	shop	7983320740	24/1 Model Colony	Kul
4.	Harish Singh	shop	9411123088	1/2 Model Colony	Kul
5.	Ankur Singh	shop	9411123088	1/2 Model Colony	Kul
6.	Harish Singh	shop	9411123088	1/2 Model Colony	Kul
7.					
8.					
9.					
10.					

Signature

*Signature
Site Engineer
Flow more Ltd.*

*Added
Safety officer
Flow more Ltd.*



Public consultation at 132 kV GIS S/s Araghar site on dated 29.05.2025



PUBLIC CONSULTATION FORM

Uttarakhand Climate Resilient Power System Development Project (PTCUL)

Funded By Asian Development Bank, (Loan no. : 4402)

Name Of Project	Construction of 132/33 KV GIS Substation Araghar, Dehradun
Location Of Public Consultation	Araghar, Dehradun
Date Of Public Consultation	29/05/2025

Topics Discussed with Participants: -

- परियोजना अवलोकन: बिजली सबस्टेशन का उद्देश्य, स्थान और लाभ।
- समयरेखा, अपेक्षित निर्माण अवधि और कार्य घंटे।
- संभावित प्रभाव: शोर, धूल, यातायात व्यवधान और पर्यावरण सुरक्षा उपाय।
- श्रमण उपाय: अशुविधाओं को कम करने के लिए कदम (जैसे, अगरोथ, धूल नियंत्रण)।
- रोजगार के अवसर: अकुशल/कुशल श्रमिकों के लिए स्थानीय भागी प्राथमिकताएँ।
- शिकायत निवारण: शिकायत कैसे दर्ज करें (जीआरएम अधिकारियों के शंपक विवरण)।
- प्रश्नोत्तर सत्र: भूमि उपयोग, सुरक्षा और दीर्घकालिक लाभों पर प्रश्नों को संबोधित किया गया।

Attendance and Signature Sheet of Participants: -

S.n	Name Of Person	Occupation	Mob. No.	Address	Signature
1	Niraj	Job	8415917318	SAHARDA, Poon	[Signature]
2	ABHINAV	Job	8145936565	"	[Signature]
3	ANIL		982326515	TABALBER	[Signature]
4	RANJEET	Job	9487982210	1000 Chaudhary Road	[Signature]
5	MANJESHI	Job	8179965688	MEERUT	[Signature]
6	Rahul	Job	6396575095	Top Badminton	[Signature]
7	Manish Singh	Marketing	9495411414	Badminton	[Signature]
8	VISHAY SINGH			Top Badminton	[Signature]
9					
10					



[Handwritten signature]

[Handwritten signature]



Flowmore Ltd.
 29/05/2025

Public consultation at 132 kV GIS S/s Araghar site on dated 28.06.2025



PUBLIC CONSULTATION FORM

Uttarakhand Climate Resilient Power System Development Project (PTCUL)

Funded By Asian Development Bank, (Loan no. :- 4402)

Name Of Project	Construction of 132/33 kV GIS Substation Araghar, Dehradun
Location Of Public Consultation	Araghar, Dehradun
Date Of Public Consultation	28/6/25

Topics Discussed with Participants:-

- परियोजना अवलोकन: बिजली सबस्टेशन का उद्देश्य, स्थान और लाभ।
- समयरेखा: अपेक्षित निर्माण अवधि और कार्य पंटे।
- संभावित प्रभाव: शोर, धूल, यातायात व्यवधान और पर्यावरण सुरक्षा उपाय।
- शमन उपाय: अशुविधाओं को कम करने के लिए कदम (जैसे, अवरोध, धूल नियंत्रण)।
- रोजगार के अवसर: अकुशल/कुशल श्रमिकों के लिए स्थानीय भर्ती प्राथमिकताएँ।
- शिकायत निवारण: शिकायत कैसे दर्ज करें (जीआरएम अधिकारियों के संपर्क वितरण)।
- प्रश्नोत्तर सत्र: भूमि उपयोग, सुरक्षा और दीर्घकालिक लाभों पर प्रश्नों को संबोधित किया गया।

Attendance and Signature Sheet of Participants:-

S. No.	Name Of Person	Occupation	Mob. No.	Address	Signature
1	Achuth	Real Estate	9557510131	12/17 Jyoti Nagar	Achuth
2	Shubham	Mobile shop	7252888888	12/17 Jyoti Nagar	Shubham
3	Somvir	Firm Owner	9997509353	12/17 Jyoti Nagar	Somvir
4	Rakesh Chandra	EDUCATION	9126916406	12/17 Jyoti Nagar	Rakesh
5	Anuj Pantwari	Private Job	7819400771	3/1 Jyoti Nagar	Anuj
6	AKSHAT	Private Job	9658966680	8-1 Jyoti Nagar	Akshat
7	CAHMAN NADIAWAL	Retired	9760932517	10/17 Jyoti Nagar	CAHMAN
8					
9					
10					



Subin
28/06/2025
JALP



Subodh
CS.P



Induction and Safety Training at 220/132/33kV Substation, Manglore.



Public Consultation at 220 kV S/S Manglore Site




PUBLIC CONSULTATION

Uttarakhand Climate Resilient Power System Development Project (PTCUL)
Funded By Asian Development Bank, (Loan no. 4402)

Name Of Project	220/132/33 KV(2X160 MVA+2X40MVA)AIS Substation, Manglore, Haridwar
Location Of Public Consultation	Kurdi Manglore
Date Of Public Consultation	15/04/2025

Discussion With Participants:-

वैतक में ग्रामीणों, पंचायत प्रतिनितियों, महिला समूहों, युवाओं एवं परियोजना अधिकारियों की भागीदारी रही।
वर्षा के मुख्य विषय:

1. *परियोजना का उद्देश्य* - हरिद्वार जिले में विद्युत आपूर्ति को विश्वसनीय और स्थायी बनाना,
2. *स्थानीय लाभ* - विजली की सतत आपूर्ति से घरेलू, कृषि और व्यावसायिक उपयोगकर्ताओं को लाभ
3. *पर्यावरणीय और सामाजिक विषय* - पर्यावरण को नुकसान न हो, इसके लिए सभी सुरक्षा उपाय किए जाएंगे, कटे हुए पेड़ों के स्थान पर वृक्षारोपण किया जाएगा
4. *स्थानीय मुद्दाव* - रास्तों की मरम्मत, कार्यस्थल पर धूल नियंत्रण, कौशल विकास और प्रशिक्षण कार्यक्रम

परियोजना अधिकारियों का आश्वासन - शिकायत निवारण की व्यवस्था की जाएगी, ग्रामीणों के मुद्दों को भागीदारी से देखा जाएगा।
सकल जानकारी और सकारात्मक सातवण में सम्पन्न हुई, जिसमें सभी प्रतिभागियों ने सहयोग व समर्थन का आश्वासन दिया।

Attendance and Signature sheet of participants:-

S. No.	Name of Person	Occupation	Mob. No.	Address	Signature
1.	रिपुल	ग्राम - अरुआ	9759779111	ग्राम - अरुआ	रिपुल
2.	शकुल कुमार	"	892377156	"	रहेल कुमार
3.	Sumit	11.0	7078771779	"	Sumit
4.	Rohit Singh	मंगलौर	9759616198	मंगलौर	Rohit
5.	Sayrav Saini	"	9759599988	"	Sayrav
6.	Shubham	"	8909673285	"	Shubham
7.	PRAVEEN SAINI	"	8445252222	"	Praveen
8.	Sachin Saini	"	9639566616	"	Sachin
9.	Ankit Saini	"	8445355409	"	Ankit





PUBLIC CONSULTATION FORM

Uttarakhand Climate Resilient Power System Development Project (PTCUL)

Funded By Asian Development Bank, (Loan no. :- 4402)

Name Of Project	Construction of 220/33 kV GIS Substation Selaqui, Dehradun
Location Of Public Consultation	Selaqui, Dehradun
Date Of Public Consultation	23/05/25

Topics Discussed with Participants: -

- परियोजना अवलोकन: बिजली सबस्टेशन का उद्देश्य, स्थान और लाभ।
- समयरेखा: अपेक्षित निर्माण अवधि और कार्य घंटे।
- संभावित प्रभाव: शोर, धूल, यातायात व्यवधान और पर्यावरण सुरक्षा उपाय।
- शमन उपाय: असुविधाओं को कम करने के लिए कदम (जैसे, अवरोध, धूल नियंत्रण)।
- रोजगार के अवसर: अकुशल/कुशल श्रमिकों के लिए स्थानीय भर्ती प्राथमिकताएँ।
- शिकायत निवारण: शिकायत कैसे दर्ज करें (जीआरएम अधिकारियों के संपर्क विवरण)।
- प्रश्नोत्तर सत्र: भूमि उपयोग, सुरक्षा और दीर्घकालिक लाभों पर प्रश्नों को संबोधित किया गया।

Attendance and Signature Sheet Of Participants:-

S.no	Name Of Person	Occupation	Mob. No.	Address	Signature
1	Rulzar Siddiqui	Shopkeeper	7011702255	Bigli Ghar Kesuma	[Signature]
2	Kafeel	"			
3	श्री हनुमान	"	8077861359	जामनपुर 2 गैलरी	[Signature]
4	चमेल	"	7817068361	जामनपुर 2 गैलरी	[Signature]
5	शक्ति	"	7906837503		[Signature]
6	अरवि शर्मा		7819814441		
7	Rankee	"	7819814441	डुफान केरा	
8					
9					
10					



[Signature]

[Signature]

Public Consultation at 220 kV S/S Selaqui Site



PUBLIC CONSULTATION FORM

Uttarakhand Climate Resilient Power System Development Project (PTCUL)

Funded By Asian Development Bank, (Loan no. :- 4402)

Name Of Project	Construction of 220/33 kV GIS Substation Selaqui, Dehradun
Location Of Public Consultation	Selaqui, Dehradun
Date Of Public Consultation	23/05/25

Topics Discussed with Participants:-

- परियोजना अवलोकन: बिजली सबस्टेशन का उद्देश्य, स्थान और लाभ।
- समयरेखा: अपेक्षित निर्माण अवधि और कार्य घंटे।
- संभावित प्रभाव: शोर, धूल, यातायात व्यवधान और पर्यावरण सुरक्षा उपाय।
- शमन उपाय: असुविधाओं को कम करने के लिए कदम (जैसे, अवरोध, धूल नियंत्रण)।
- रोजगार के अवसर: अकुशल/कुशल श्रमिकों के लिए स्थानीय भर्ती प्राथमिकताएँ।
- शिकायत निवारण: शिकायत कैसे दर्ज करें (जीआरएम अधिकारियों के संपर्क विवरण)।
- प्रश्नोत्तर सत्र: भूमि उपयोग, सुरक्षा और दीर्घकालिक लाभों पर प्रश्नों को संबोधित किया गया।

Attendance and Signature Sheet Of Participants:-

S.no	Name Of Person	Occupation	Mob. No.	Address	Signature
1	Rulzar Siddiqui	Shopkeeper	7011702255	Bigli Ghar Kesimna	[Signature]
2	Kafeel	"			
3	श्री हनुमान	"	8077861359	जामन पुर्नमपुरी	[Signature]
4	चम्पल	"	7817068361	जामन पुर्नमपुरी	[Signature]
5	किशोर	"	7906837503		[Signature]
6	अरविश्री		781981444		
7	Ronka	"	781981444	डुफान केर	
8					
9					
10					



[Signature]

[Signature]

